


25U-220

LINE

120/240V

120/240V

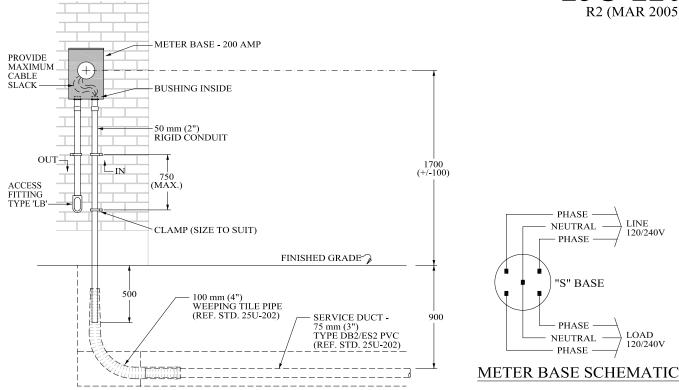

NOTES:

- 1. THE 200 AMP METER BASE SHALL BE OF A TYPE APPROVED BY THE DISTRIBUTOR.
- 2. THE METER BASE SHALL BE SUPPLIED AND INSTALLED BY THE CUSTOMER.
- 3. ALL METER BASE INSTALLATION SHALL BE IN ACCORDANCE WITH THE ONTARIO ELECTRICAL SAFETY CODE.
- 4. THE SERVICE ROUTE AND METER BASE LOCATION SHALL BE AS PER STD. 25U-205 OR 25U-208.
- 5. THE SERVICE TRENCH INSTALLATION SHALL BE AS PER STD. 25U-202.
- 6. THE METER BASE SHALL BE MOUNTED BY MEANS OF FOUR (4) #12 X 1.5" SCREWS C/W LEAD ANCHORS AND BELLEVILLE WASHERS.
- 7. ENSURE LIBERAL USE OF "PENETROX A" ON CONNECTION BETWEEN THE ALUMINUM CONDUCTORS/LUGS AND TERMINALS OF METER BASE.
- 8. ENSURE ALUMINUM CONNECTIONS ARE WELL TIGHTENED TO THE TERMINALS OF METER BASE (23 FT-LBS OF TOROUE).
- 9. THE SERVICE CONDUIT SHALL HAVE A PLASTIC (INSULATING) BUSHING INSIDE THE METER BASE.
- 10. NO ATTACHMENT SHALL BE PERMITTED TO THE CONDUITS.
- 11. THE METER BASE AND CONDUITS SHALL HAVE A 1.0 M RADIAL OBSTRUCTION FREE AREA FROM GAS METERS, COMMUNICATION STRUCTURES, FENCES, TREES, PLANTS, SHRUBS AND OTHER STRUCTURES THAT OWNERS MAY INSTALL.

RESIDENTIAL SECONDARY SERVICE INSTALLATION -200 AMP, METER BASE

Milton Hydro Distribution Inc.