


25U-240 R2 (MAR 2005)

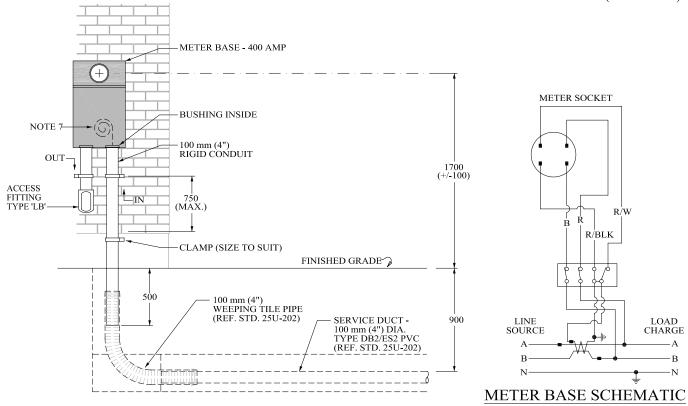

NOTES:

- 1. THE 400 AMP METER BASE SHALL BE OF A TYPE APPROVED BY THE DISTRIBUTOR.
- 2. THE METER BASE SHALL BE SUPPLIED AND INSTALLED BY THE CUSTOMER.
- 3. ALL METER BASE INSTALLATION SHALL BE IN ACCORDANCE WITH THE ONTARIO ELECTRICAL SAFETY CODE.
- 4. THE SERVICE ROUTE AND METER BASE LOCATION SHALL BE AS PER STD. 25U-205.
- 5. THE SERVICE TRENCH INSTALLATION SHALL BE AS PER STD. 25U-202.
- 6. THE METER BASE SHALL BE MOUNTED BY MEANS OF FOUR (4) 3/8" X 3" SCREWS WITH LEAD ANCHORS AND BELLEVILLE WASHERS.
- 7. INSIDE THE METER BASE, ALL CONDUCTORS EXCEPT FOR NEUTRAL SHALL REQUIRE EXTRA 600 mm LOOP OF CABLES MEASURED FROM THE METER BASE TERMINALS.
- 8. THE SERVICE CONDUITS SHALL HAVE PLASTIC (INSULATING) BUSHINGS INSIDE THE METER BASE.
- 9. NO ATTACHMENT SHALL BE PERMITTED TO THE CONDUITS.
- 10. THE METER BASE AND CONDUITS SHALL HAVE A 1.0 M RADIAL OBSTRUCTION FREE AREA FROM GAS METERS, COMMUNICATION STRUCTURES, FENCES, TREES, PLANTS, SHRUBS AND OTHER STRUCTURES THAT OWNERS MAY INSTALL.

RESIDENTIAL SECONDARY SERVICE INSTALLATION - 400 AMP, METER BASE

Milton Hydro Distribution Inc.